

# STATE OF UTAH MSE WALL INSPECTION FORM

Compiled As Part of Research By The Utah Department of Transportation

**Instructions:**

- 1- Fill out required sections for MSE Wall Inspector and Wall Characteristics.
- 2- Inspect the wall using the attached form. Questions that require a 'Yes' answer should be documented by noting the extent of the problem in the right most column and photo documentation. Photo documentation should consist of wall or bridge number, nature of problem, date, photo number for wall, and a size reference, which should be indicated in the photo (white board/paper). Photos taken should be placed on the Top View layout and indicated with the appropriate number. Note should be taken by the inspector that often anomalies are due to construction and should be distinguished from those that are a result of post-construction. If it is observable that they existed at the time of construction note should be taken in the space provided for drawings.
- 3- Shoot digital photos of the entire wall. This may require the use of a variety of shots and angles on each wall to cover the wall in its entirety.
- 4- Indicate Layout of MSE Wall in respect to major intersections, roadways, potential hazards, irrigation, vegetation, locations of conditions for which 'Yes' was marked, etc. in space provided below. Also Indicate approximate GPS Coordinates of Site of Interest in space provided below

<b>Region</b>	2	<b>Identifying Road/Intersection</b>	E-15, 600 N, SLC
---------------	---	--------------------------------------	------------------

## MSE WALL CHARACTERISTICS


MSE Wall at Bridge	(Y) N	Bridge Number if applicable:		Wall Number	R-337-A
Surrounding Structures				Maximum Height of Wall (ft)	22 ft
Distance to Each Structure				One Stage, Two Stage or Block Wall	2-stage
State Route Number				Estimated Max Length of Wall Abutment:	120 ft
Approximate Mile Marker				Max Slope of Ground in front of wall:	0
GPS Datum	WGS/84, NAD/83, or NAD/27			Max Height of wall burial line above surrounding level ground:	15 ft
MSE Wall GPS Coordinates (Location of Measurement shown on plan view)	40°46'55.28"N 111°54'39.67"W			Please draw rough layout of panel with approximate dimensions in space provided below:	
If known, Panel or System Manufacturer	<div style="border: 1px solid black; width: 100%; height: 100%; position: relative;"> <div style="position: absolute; top: 50%; left: 50%; transform: translate(-50%, -50%);"> </div> </div>				

SW



**Summary of Key Observations:**

sagging approach, coping settling

Plan View/Drainage:

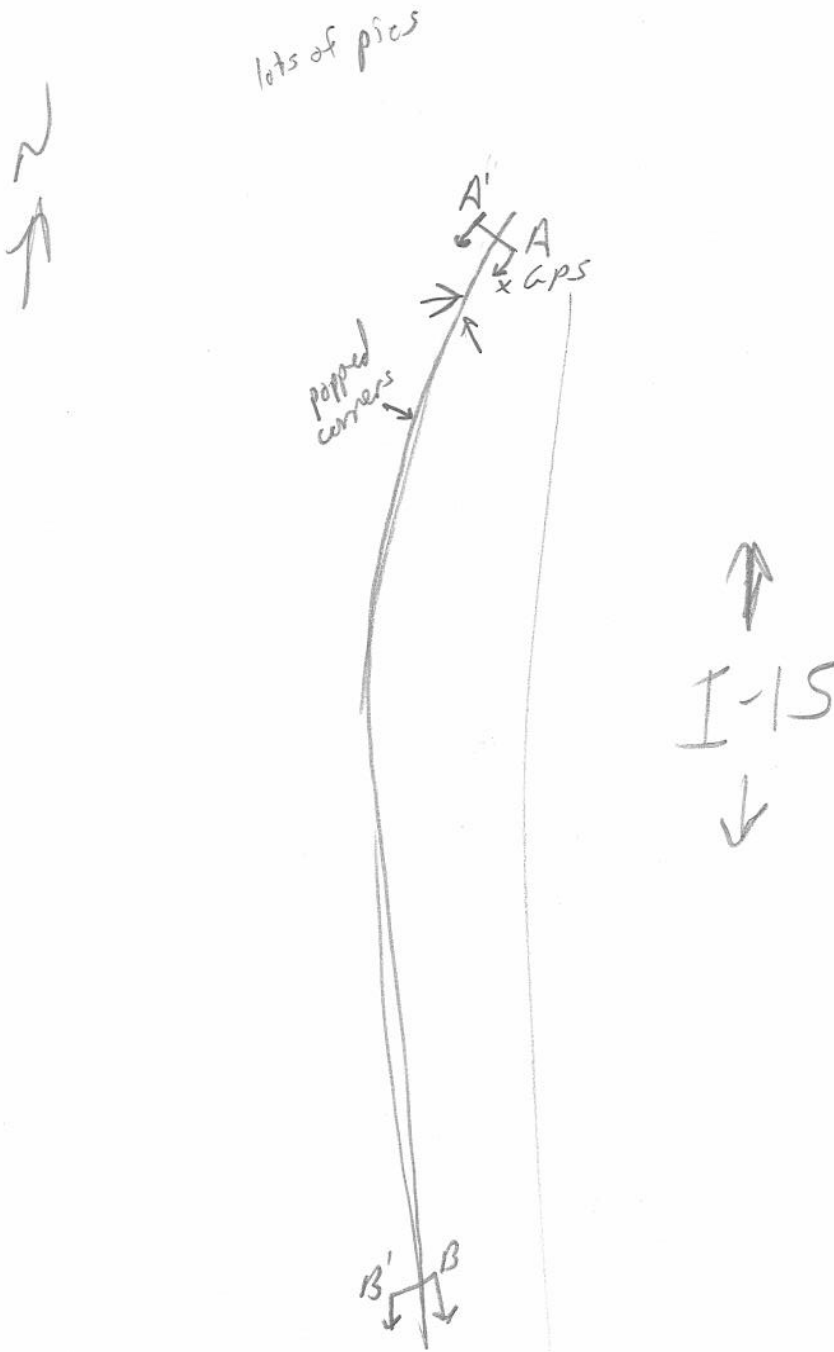

Cross Sections:

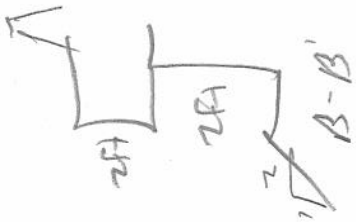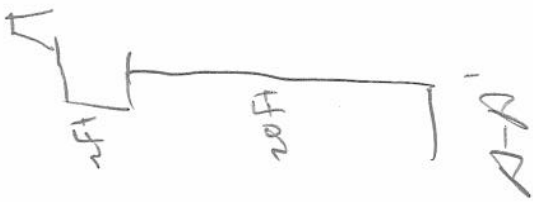

Cross Sections:

RISE WALL DRAINAGE

Required Tester: NYS Storm Water Inspector-Certified		Measurement/Extent of Problem/Location/Photo Numbers
Yes	N/A UKN	Drainage
Y	N/A UKN	1-Is there an active water source near the toe of the wall (in the wall near a body of water with seepage potential)?
Y	N/A UKN	2-If applicable, are the catch basins at the base of the wall blocked?
Y	N/A UKN	3-Are there culverts protruding through the wall?
Y	N/A UKN	4-Are there vertical drains that extend through the backfill?
Y	N/A UKN	5-Is there erosion at the base of the wall or leveling pad? (Photo 12)
Y	N/A UKN	6-Is there erosion along the wing wall?
Y	N/A UKN	7-Are there any signs of water flow along the base of the wall?
Y	N/A UKN	8-Is there less than 1.5 feet between irrigation sprinklers and wall?
Y	N/A UKN	9-Does the backfill or joint fabric appear to be saturated?
Y	N/A UKN	10-Is there vegetation growing in pond joints (Photo 8)?
Y	N/A UKN	11-Are the back drains and outlets at the top of the wall blocked? (Photo 14)
Y	N/A UKN	12-Can water enter the wall between coping and deck (i.e., Drain approximately)?
Y	N/A UKN	13-Is there evidence of discharge point of fill washing through drain pipes?
		Blocked
		Clear
		0-50% 15% 5% 10% 25% 50% 75% 90% 95% 100% /
		Partial
		0-50% 15% 5% 10% 25% 50% 75% 90% 95% 100% /
		0-50% 15% 5% 10% 25% 50% 75% 90% 95% 100% /
		0-50% 15% 5% 10% 25% 50% 75% 90% 95% 100% /

RISE WALL JOINTS

Required Tester: Long Level-Sling-Certified		Measurement/Extent of Problem/Location/Photo Numbers
Yes	N/A UKN	14-Is backfill coming out of joints or are there joints of backfill at the base of the wall? (Photos 2 & 3)
Y	N/A UKN	15-Are the joints wide enough to see fabric or backfill behind panels when looking into joints? (Photo 5) If yes, record the approximate maximum joint width in inches.
Y	N/A UKN	16-Is exposed backfill within the horizontal joint? (Photo 4)
Y	N/A UKN	17-Are there visible tears in the fabric? Is there evidence of backfill or water leaking through tear? (Do not include additional damage to fabric)
Y	N/A UKN	18-Do the joints have a non-uniform horizontal spacing/delta? Are some horizontal joints larger smaller than others? (Photo 9)
Y	N/A UKN	19-Do the joints have a non-uniform vertical spacing/delta? Are some vertical joints larger smaller than others? (Photo 6)
Y	N/A UKN	20-Are the panels offset at the joints either in or out of the wall? (Photo 7) If yes, record the approximate maximum offset.
Y	N/A UKN	21-Does the fabric appear brittle, or appear as if it has undergone excessive UV exposure?
		1.5"

RISE WALL FACING

Required Tester: Long Level-Sling-Certified		Measurement/Extent of Problem/Location/Photo Numbers
Yes	N/A UKN	22-Are the panels "10'-Up" 7' Is there excessive cracking in the panels?
Y	N/A UKN	23-Are there cracks that continue vertically through adjacent panels? (Photos 9 & 10)? If yes, record the approximate number of panels in the wall with cracking.
Y	N/A UKN	24-Are there cracks that continue horizontally through adjacent panels? (Photos 9 & 10)? If yes, record the approximate number of panels in the wall with cracking.
Y	N/A UKN	25-Are the panel concrete making contact with each other? If yes, record the approximate number in the wall.
Y	N/A UKN	26-Are the panel corners "popped-off" or chipped from contact with an adjacent panel? If yes record the number in the wall.
Y	N/A UKN	27-Does crack spacing suggest Differential Settlement?
Y	N/A UKN	28-Does the existing coping exhibit Vertical Offset?
Y	N/A UKN	29-Are the coping and parapets loose or detaching? If yes, it may be appropriate to contact UDOT if detachment occurs routinely.
Y	N/A UKN	30-Are the panels in danger of falling off? (If potential exists contact appropriate UDOT region).
Y	N/A UKN	31-Are the panels bulging (bowing horizontally)? If so, record maximum deflection from accessible coping to leveling pad. (Photo 11)
Y	N/A UKN	32-Is there "ripping" at the top or bottom of the wall? (Record maximum degree of ripping from azimuth using vertical level and off-level area).

RISE TOP OF WALL OBSERVATIONS

Required Tester: Long Level-Cord-Grade-Certified		Measurement/Extent of Problem/Location/Photo Numbers
Yes	N/A UKN	33-Is there evidence of settlement at the top of the wall? (government cracking, etc)
Y	N/A UKN	34-Are there any open cracks in the concrete coping (not handling)? If yes record the approximate maximum crack width.
Y	N/A UKN	35-Do the construction joints in the connecting coping spread up? (Photo 6). If yes, record the maximum joint width.

near bridge

Required Issue:		Yes	No	NA	UKS	Comments	Measurements/Extent of Problem/Location/Photo Numbers
<input checked="" type="checkbox"/>	36-Is there a large gap between the approach slab and the approach pavement? (Photos 15) Often this produces a bumping sensation as the approach is entered. Record the approximate maximum gap size.	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	37-Are the abutments, bar the joint between the wall coping and the abutment stepped up significantly? If so record maximum distance.	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	38-Is the coping wall pulling away from pavement (roadway section)? Please record maximum displacement.	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

MSE 31 (A) (1) (1)

Required Issue:		Yes	No	NA	UKS	Comments	Measurements/Extent of Problem/Location/Photo Numbers
<input checked="" type="checkbox"/>	39-What is the finishing depth of leveling pad? Found One Probe from wall located 2 inches from wall to a maximum depth of 24 inches (24 inches is the minimum depth for MSE Wall)	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	40-Is leveling pad exposed?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	41-Is there cracking in the leveling pad? If so, record maximum crack size with gaps.	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	42-Is there a four foot back level slope directly along the wall before the slope changes (Record backfill above top of wall.)	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	43-Is there a slope steeper than V: 1.5 to H:1 in front of the wall? Please record slope and height of backfill above top of wall.	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	44-Is there a slope greater than V: 1.5 to H:1 below the wall? Please record slope and height of backfill below the wall.	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	45-Is there concrete degradation of panel face?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

MSE METAL CORROSION

Required Issue:		Yes	No	NA	UKS	Comments	Measurements/Extent of Problem/Location/Photo Numbers
<input checked="" type="checkbox"/>	46-Does the steel reinforcement mesh (rebar) show signs of corrosion? (Record the extent of corrosion.)	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	47-Are there major rust stains on the face panel? Along joints? If so, record rust number.	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	48-Are any internal steps exposed? Does there appear to be corrosion on these steps? If applicable please record the total number of steps affected.	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	49-Does any rebar protrude from the exposed wall? If so, please indicate depth in inches.	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	50-Is there any indication of rebar corrosion (swelling bars, rust, exposed metal inside epoxy coating)? If so, please record the total number of panels affected.	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

MSE IMPACT/COLLISION PROTECTION

Required Issue:		Yes	No	NA	UKS	Comments	Measurements/Extent of Problem/Location/Photo Numbers
<input checked="" type="checkbox"/>	51-Is there guardrails wall protrusion in place at the base of the wall (to protect it from potential traffic hazard)?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	52-Does it appear that the wall has been involved in an accident (replaced panel, recent damage to the wall)?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	53-Does it appear the wall's functionality and integrity has been compromised by a collision or accident?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

MSE OBSTRUCTIONS IN REINFORCEMENT GEOMETRY

Required Issue:		Yes	No	NA	UKS	Comments	Measurements/Extent of Problem/Location/Photo Numbers
<input checked="" type="checkbox"/>	54-Are there obstructions in Reinforcement Geometry?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

MSE AS BUILT DIFFERENT FROM DESIGN

Required Issue:		Yes	No	NA	UKS	Comments	Measurements/Extent of Problem/Location/Photo Numbers
<input checked="" type="checkbox"/>	55-Are there available drawings for the wall? Please indicate type (Situation and Layout, Design, As Built, etc)	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	56-Is the layout in general accordance with drawing?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	57-Are the panel C/P (Cut in Place) Doors there appear to be excessive cracking in the panel?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	58-Was OCE/Item used in the construction of the wall?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	59-Are there any encumbrance on or near wall that were not included in initial drawing?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	60-Are there any excavations or evidence of excavation near the wall?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	61-Has there been any vegetation, utility, or intrusion that are not part of the initial drawing?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	62-Has local property owners changed the dynamics of the wall (additional structures, irrigation, vegetation, etc)?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>	63-Are there piles located in the wall (bridge abutment)?	<input checked="" type="checkbox"/>					/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /