

STATE OF UTAH MSE WALL INSPECTION FORM

Compiled As Part of Research By The Utah Department of Transportation

Instructions:

1-Fill out required sections for MSE Wall Inspector and Wall Characteristics.

2-Inspect the wall using the attached form. Questions that require a 'Yes' answer should be documented by noting the extent of the problem in the right most column and photo documentation. Photo documentation should consist of wall or bridge number, nature of problem, date, photo number for wall, and a size reference, which should be indicated in the photo (white board/paper). Photos taken should be placed on the Top View layout and indicated with the appropriate number. Note should be taken by the inspector that often anomalies are due to construction and should be distinguished from those that are a result of post-construction. If it is observable that they existed at the time of construction note should be taken in the space provided for drawings.

3- Shoot digital photos of the entire wall. This may require the use of a variety of shots and angles on each wall to cover the wall in its entirety.

4- Indicate Layout of MSE Wall in respect to major intersections, roadways, potential hazards, irrigation, vegetation, locations of conditions for which 'Yes' was marked, etc. in space provided below. Also Indicate approximate GPS Coordinates of Site of Interest in space provided below

| | | | |
|---------------|---|--------------------------------------|-------------------|
| Region | 2 | Identifying Road/Intersection | ITS, Fayette Ave. |
|---------------|---|--------------------------------------|-------------------|


MSE WALL CHARACTERISTICS

| | | | | | |
|---|---|------------------------------|--|-----------------------------|----------|
| MSE Wall at Bridge | (Y) N | Bridge Number if applicable: | | Wall Number | R-350-14 |
| Surrounding Structures | | | | Maximum Height of Wall (ft) | 23 ft |
| Distance to Each Structure | | | One Stage, Two Stage or Block Wall | | ~ Staged |
| State Route Number | | | Estimated Max Length of Wall Abutment: | | 680 ft |
| Approximate Mile Marker | | | Max Slope of Ground in front of wall: | | 0 |
| GPS Datum | WGS/84, NAD/83, or NAD/27 | | Max Height of wall burial line above surrounding level ground: | | 22 ft |
| MSE Wall GPS Coordinates (Location of Measurement shown on plan view) | 40° 44' 50.68" N 111° 54' 22.31" W | | Please draw rough layout of panel with approximate dimensions in space provided below: | | |
| If known, Panel or System Manufacturer | <div style="border: 1px solid black; width: 200px; height: 100px; margin: 0 auto; position: relative;"> 100 5' </div> | | | | |



Summary of Key Observations:

some tipping in panels on north end; though most of the wall was plumb.

Plan View/Drainage:

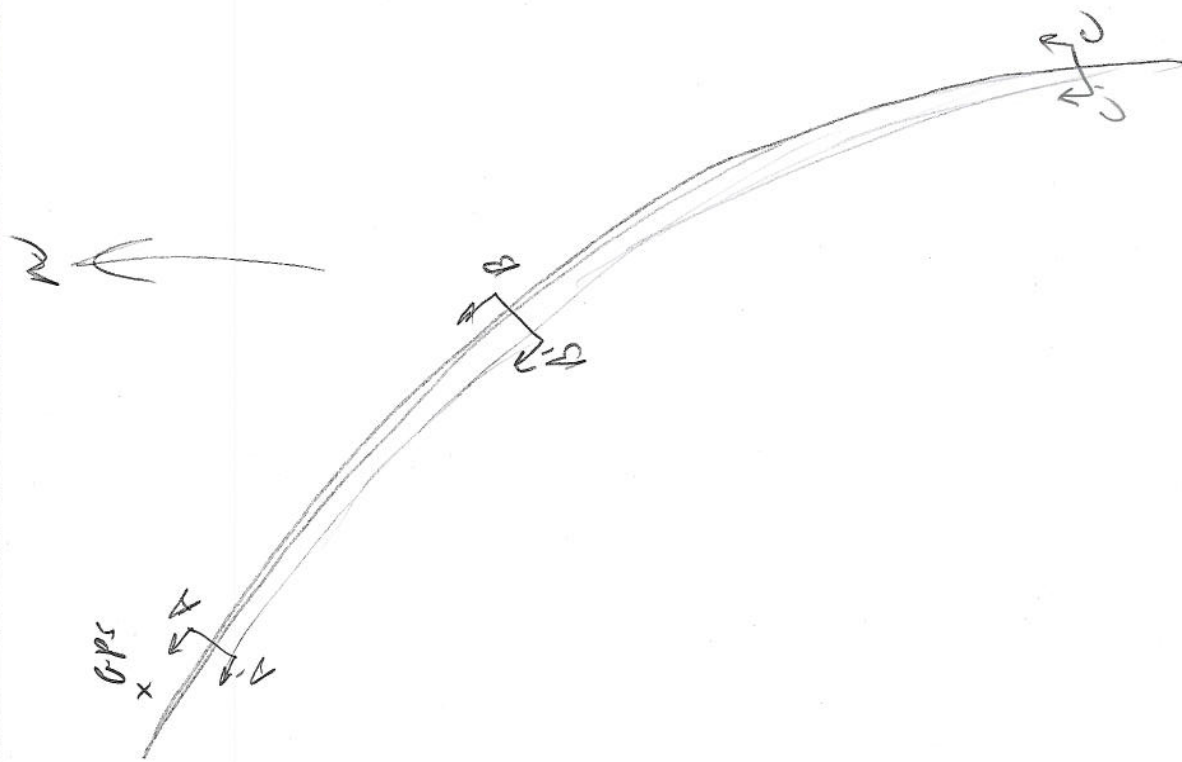

Cross Sections:

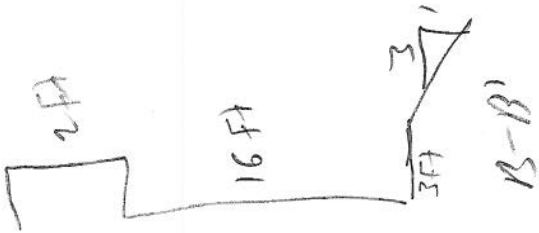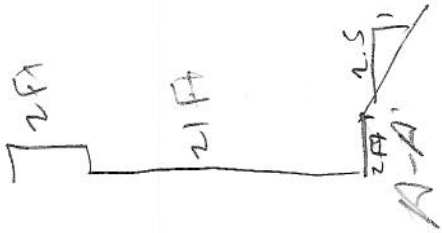

Cross Sections:

NISE WALL DRAINAGE

| Required Items | | NISE Meter-Work-Check-OPS-Items | | Measurement/Extent of Problem/Location/Photo Numbers | |
|----------------|----|---------------------------------|-----|--|---|
| Yes | No | N/A | UKN | 1-Is there an active water source near the base of the wall (is the wall near a body of water with sewer potential)? | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 2-Is it applicable, are the earth behind the base of the wall blocked? | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 3-Are there culverts protruding through the wall? | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 4-Are there vertical drains that run through the backfill? | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 5-Is there erosion at the base of the wall or leveling pad? (Photo 12) | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 6-Is there erosion along the 'wing wall'? | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 7-Are there any signs of water flow along the base of the wall? | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 8-Is there less than 14 feet between irrigation sprinklers and wall? | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 9-Does the backfill or joint fabric appear to be saturated? | Partial / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 10-Is there vegetation growing in joint fabric? | Blocked / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 11-Are the back fabric and outlets at the top of the wall blocked? (Photo 14) | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 12-Can water enter the wall between coping and abut (i.e. debris appropriately)? | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 13-Is there evidence at discharge point of fill washing through drain pipe? | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |

NISE WALL JOINTS

| Required Items | | Long Level-String-OPS-Items | | Measurement/Extent of Problem/Location/Photo Numbers | |
|----------------|----|-----------------------------|-----|--|---|
| Yes | No | N/A | UKN | 1-Is backfill coming out of joints or are there piles of backfill at the base of the wall? (Pictures 2 & 3) | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 15-Is the joint wide enough to see fabric or backfill behind panels when looking into joint? (Photo 5) If yes, record the approximate maximum joint width in inches. | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 16-Is exposed backfill visible in the horizontal joint? (Photo 5) | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 17-Are there visible tears in the fabric? Is there evidence of backfill or water leaking through wall? (Do not induce additional damage to fabric) | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 18-Do the joints have a non-uniform horizontal spacing? Are some horizontal joints larger/smaller than others? (Photo 6) | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 19-Do the joints have a non-uniform vertical spacing? Are some vertical joints larger/smaller than others? (Photo 6) | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 20-Are there voids or offsets at the joints either in or out of the wall? (Photo 7) If yes, record the approximate maximum offset. | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 21-Does the fabric appear brittle, or appear as if it has undergone excessive UV exposure? | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |

NISE WALL PACING

| Required Items | | Long Level-String-OPS-Items | | Measurement/Extent of Problem/Location/Photo Numbers | |
|----------------|----|-----------------------------|-----|---|---|
| Yes | No | N/A | UKN | 1-Is there excessive cracking in the panel? | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 22-Are there cracks that combine vertically through adjacent panels (Photos 9 & 10)? If yes, record the approximate number of panels in the wall with cracking. | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 23-Are there cracks that combine horizontally through adjacent panels (Photos 9 & 10)? If yes, record the approximate number of panels in the wall with cracking. | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 24-Are there panel corner cracking with each other? If yes, record the approximate number in the wall. | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 25-Are there 'beeped-off' or chipped from contact with an adjacent panel? If yes record the number in the wall. | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 26-Does crack spacing suggest Differential Settlement? | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 27-Does the overlying coping exhibit Vertical Offset? | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 28-Are the coping and parapets loose or dislodging? If yes, it may be appropriate to contact UDOT if detachment seems imminent. | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 29-Are the panels in danger of falling off? (If potential exist contact appropriate UDOT region). | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 30-Are the panels bulging (bowing horizontally)? If yes, record maximum deformation from accessible coping to leveling pad (Photo 11) | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 31-Is there 'flipping' at the top or bottom of the wall? (Record maximum degree of flipping from minimum using vertical level and official area) | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |

could be construction

NISE TOP OF WALL OBSERVATIONS

| Required Items | | Long Level-String-OPS-Items | | Measurement/Extent of Problem/Location/Photo Numbers | |
|----------------|----|-----------------------------|-----|--|---|
| Yes | No | N/A | UKN | 1-Is there evidence of settlement at the top of the wall? (pavement cracking, etc) | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 32-Is there any signs of water in the concrete coping (see building)? If yes record the approximate maximum crack width. | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |
| Y | N | N/A | UKN | 33-Is there any signs of water in the concrete coping around up? (Photo 6) If yes, record the maximum joint width. | / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% / |

| | | | | | | | | | | | | | | | |
|---|---|----|-----|---|---|------|----|----|-----|-----|-----|-----|-----|-----|------|
| Y | N | NA | UKS | 36-Is there a large gap between the approach slab and the approach pavement? (Photo 13) Other than the producers a bumping sensation as the car is crossed. Record the abutment maximum gap size. | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 37-Ar the abutment, has the joint between the wall coping and the abutment opened up significantly? If so record maximum distance. | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 38-Is the coping well pulling away from pavement/roadway section? Please record maximum displacement of wall. | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |

NISE STABILITY

| Required tests: | | Structural Integrity | | Measurement/Extent of Problem/Location/Photo Numbers | | | | | | | | | | | |
|-----------------|---|----------------------|-----|---|---|------|----|----|-----|-----|-----|-----|-----|-----|------|
| Y | N | NA | UKS | 39-What is the location depth of leveling pad? Found One Probe for wall located 2 inches from wall as a maximum depth of 24 inches (24 inches is the minimum depth for NISE Wall) | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 40-Is leveling pad exposed? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 41-Is there cracking in the leveling pad? If so, record maximum crack size with page. | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 42-Is there a four foot back (level slope) directly along the wall before the slope changes (Record) | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 43-Is there a slope steeper than V: 1.3 to H: 1 in front of the wall? Please record slope and height of backfill above top of wall. | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 44-Is there a slope greater than V: 1.3 to H: 1 below the wall? Please record slope and height of backfill below the wall. | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 45-Is there excessive degradation of panel face? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |

NISE METAL CORROSION

| Required tests: | | NISE METAL CORROSION | | Measurement/Extent of Problem/Location/Photo Numbers | | | | | | | | | | | |
|-----------------|---|----------------------|-----|---|---|------|----|----|-----|-----|-----|-----|-----|-----|------|
| Y | N | NA | UKS | 46-Is there excessive corrosion on guardrails or other exposed metal that might indicate concrete condition? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 47-Are there major rust stains on the face panel? Along joints? If so, record total number. | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 48-Are any internal straps exposed? Does there appear to be corrosion on these straps? If applicable please record the total number of straps affected. | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 49-Was a reliability sample taken of exposed wall? If so, please indicate depth in inches. | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 50-Is there any indication of rebar corrosion (swelling bars, rust, exposed metal inside epoxy coating)? If so please record the total number of points affected. | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |

NISE IMPACT/COLLISION PROTECTION

| Required tests: | | Impact/Collision | | Measurement/Extent of Problem/Location/Photo Numbers | | | | | | | | | | | |
|-----------------|---|------------------|-----|--|---|------|----|----|-----|-----|-----|-----|-----|-----|------|
| Y | N | NA | UKS | 51-Are guardrails wall protrusions in place at the base of the wall (to prevent it from potential traffic hazard)? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 52-Does it appear that the wall has been involved in an accident (replaced panel, recent ding in the wall)? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 53-Does it appear the wall has been involved in an accident (replaced panel, recent ding in the wall)? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 54-Does it appear the wall structurally and integrity has been compromised by a collision or accident? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |

NISE OBSTRUCTIONS IN REINFORCEMENT GEOMETRY

| Required tests: | | Obstructions in Reinforcement Geometry | | Measurement/Extent of Problem/Location/Photo Numbers | | | | | | | | | | | |
|-----------------|---|--|-----|--|---|------|----|----|-----|-----|-----|-----|-----|-----|------|
| Y | N | NA | UKS | 55-Is there some wall angle (90)? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |

NISE AS BUILT DIFFERENT FROM DESIGN

| Required tests: | | Drawings-Current-GIS | | Measurement/Extent of Problem/Location/Photo Numbers | | | | | | | | | | | |
|-----------------|---|----------------------|-----|---|---|------|----|----|-----|-----|-----|-----|-----|-----|------|
| Y | N | NA | UKS | 55-Are there available drawings for the wall? Please indicate type (Situation and Layout, Design, As Built, etc.) | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 56-Is the layout in general accordance with drawing? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 57-Are the panels CIP (Cast in Place) Does there appear to be excessive cracking in the panels? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 58-Was OBE/room used in the construction of the wall? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 59-Are there any structures on or near wall that were not included in initial drawings? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 60-Are there any irrigation, utilities, or foundation that are not part of the initial drawings? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 61-Is there any excavation or evidence of excavation next to the wall? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 62-Is there any excavation or evidence of excavation next to the wall? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 63-Is there any vegetation, etc.? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |
| Y | N | NA | UKS | 64-Is there piles located in the wall (bridge abutment)? | / | 0-No | 1% | 5% | 10% | 25% | 50% | 75% | 90% | 95% | 100% |