

STATE OF UTAH MSE WALL INSPECTION FORM


Compiled As Part of Research By The Utah Department of Transportation

Instructions:

- 1-Fill out required sections for MSE Wall Inspector and Wall Characteristics.
- 2-Inspect the wall using the attached form. Questions that require a 'Yes' answer should be documented by noting the extent of the problem in the right most column and photo documentation. Photo documentation should consist of wall or bridge number, nature of problem, date, photo number for wall, and a size reference, which should be indicated in the photo (white board/paper). Photos taken should be placed on the Top View layout and indicated with the appropriate number. Note should be taken by the inspector that often anomalies are due to construction and should be distinguished from those that are a result of post-construction. If it is observable that they existed at the time of construction note should be taken in the space provided for drawings.
- 3- Shoot digital photos of the entire wall. This may require the use of a variety of shots and angles on each wall to cover the wall in its entirety.
- 4- Indicate Layout of MSE Wall in respect to major intersections, roadways, potential hazards, irrigation, vegetation, locations of conditions for which 'Yes' was marked, etc. in space provided below. Also Indicate approximate GPS Coordinates of Site of Interest in space provided below

Region	2	Identifying Road/Intersection	123005, I-15, 5LC (Draped)


MSE WALL CHARACTERISTICS

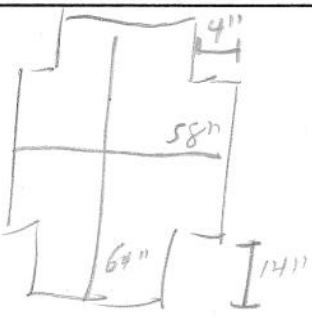MSE Wall at Bridge	(Y) N	Bridge Number if applicable:		Wall Number	R-411 H
Surrounding Structures				Maximum Height of Wall (ft)	15 FT
Distance to Each Structure				One Stage, Two Stage or Block Wall	
State Route Number				Estimated Max Length of Wall Abutment:	130 FT
Approximate Mile Marker				Max Slope of Ground in front of wall:	0
GPS Datum		WGS/84, NAD/83, or NAD/27		Max Height of wall burial line above surrounding level ground:	0
MSE Wall GPS Coordinates (Location of Measurement shown on plan view)	Please draw rough layout of panel with approximate dimensions in space provided below:				
If known, Panel or System Manufacturer					

Summary of Key Observations:

Vines

Plan View/Drainage:

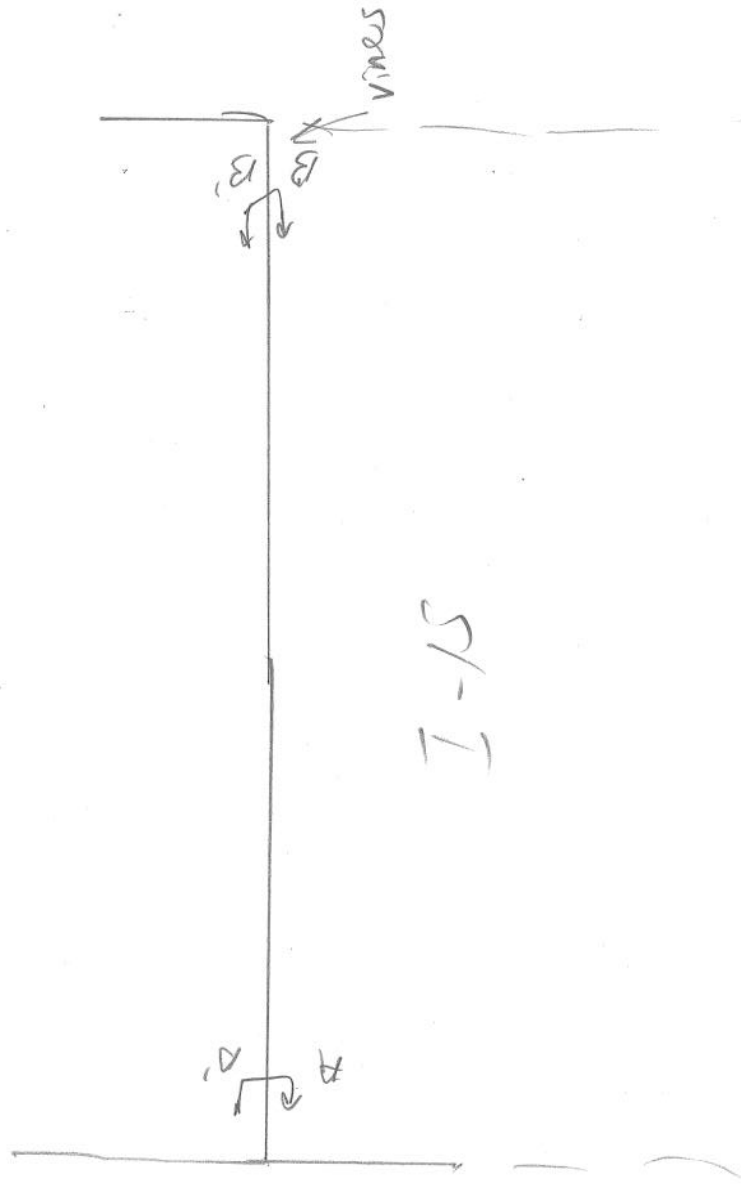

Cross Sections:



Cross Sections:

BASE WALL DRAINAGE

Required Task	Yes	No	N/A	UNKN	Drainage	Measurement/Extent of Problem/Location/Photo Numbers
14-Is there an active water source near the base of the wall (e.g. the wall near a body of water with seepage)?	Y	N	N/A	UNKN	Drainage	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
2-If applicable, are the mesh holes at the base of the wall blocked?	Y	N	N/A	UNKN	2-If applicable, are the mesh holes at the base of the wall blocked?	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
3-Are there culverts protruding through the wall?	Y	N	N/A	UNKN	3-Are there culverts protruding through the wall?	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
4-Are there vertical drains that travel through the backfill?	Y	N	N/A	UNKN	4-Are there vertical drains that travel through the backfill?	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
5-Is there erosion at the base of the wall or leveling pad? (Photo 12)	Y	N	N/A	UNKN	5-Is there erosion at the base of the wall or leveling pad? (Photo 12)	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
6-Is there erosion along the wing wall?	Y	N	N/A	UNKN	6-Is there erosion along the wing wall?	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
7-Are there any signs of water flow along the base of the wall?	Y	N	N/A	UNKN	7-Are there any signs of water flow along the base of the wall?	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
8-Is there less than 14 feet between irrigation sprinklers and wall?	Y	N	N/A	UNKN	8-Is there less than 14 feet between irrigation sprinklers and wall?	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
9-Does the backfill or joint fabric appear to be saturated?	Y	N	N/A	UNKN	9-Does the backfill or joint fabric appear to be saturated?	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
10-Is there vegetation growing in panel joints (Photo 8)?	Y	N	N/A	UNKN	10-Is there vegetation growing in panel joints (Photo 8)?	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
11-Are the deck, drains and outlets at the top of the wall blocked? (Photo 14)	Y	N	N/A	UNKN	11-Are the deck, drains and outlets at the top of the wall blocked? (Photo 14)	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
12-Can water enter the wall between coping and slab (i.e., drain appropriately)?	Y	N	N/A	UNKN	12-Can water enter the wall between coping and slab (i.e., drain appropriately)?	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
13-Is there evidence of fill washing through drain pipe?	Y	N	N/A	UNKN	13-Is there evidence of fill washing through drain pipe?	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

erect from wall

lines

MISE WALL JOINTS

Required Task	Yes	No	N/A	UNKN	Long Level-String-Camers-Crack	Measurement/Extent of Problem/Location/Photo Numbers
14-Is backfill coming out of joints or are there piles of backfill at the base of the wall? (Pictures 2 & 3)	Y	N	N/A	UNKN	14-Is backfill coming out of joints or are there piles of backfill at the base of the wall? (Pictures 2 & 3)	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
15-Are the joints wide enough to see fabric or backfill behind panels when looking into joint? (Photo 5) If yes, record the approximate maximum joint width in inches.	Y	N	N/A	UNKN	15-Are the joints wide enough to see fabric or backfill behind panels when looking into joint? (Photo 5) If yes, record the approximate maximum joint width in inches.	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
17-Is there any evidence of backfill or water leaking through joint? (Do not include additional damage to fabric)	Y	N	N/A	UNKN	17-Is there any evidence of backfill or water leaking through joint? (Do not include additional damage to fabric)	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
18-Do the joints have a non-uniform horizontal spacing/delta? Are some horizontal joints larger/smaller than others? (Photo 6)	Y	N	N/A	UNKN	18-Do the joints have a non-uniform horizontal spacing/delta? Are some horizontal joints larger/smaller than others? (Photo 6)	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
19-Do the joints have a non-uniform vertical spacing/delta? Are some vertical joints larger/smaller than others? (Photo 6)	Y	N	N/A	UNKN	19-Do the joints have a non-uniform vertical spacing/delta? Are some vertical joints larger/smaller than others? (Photo 6)	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
20-Are the panels offset at the joints either in or out of the wall? (Photo 7) If yes, record the approximate maximum offset.	Y	N	N/A	UNKN	20-Are the panels offset at the joints either in or out of the wall? (Photo 7) If yes, record the approximate maximum offset.	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
21-Does the fabric appear brittle, or appear as if it has undergone excessive UV exposure?	Y	N	N/A	UNKN	21-Does the fabric appear brittle, or appear as if it has undergone excessive UV exposure?	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

MISE WALL FACING

Required Task	Yes	No	N/A	UNKN	Wall Facing	Measurement/Extent of Problem/Location/Photo Numbers
22-Are there cracks that continue vertically through adjacent panels (Photos 9 & 10)? If yes, record the approximate number of panels in the wall with cracking.	Y	N	N/A	UNKN	22-Are there cracks that continue vertically through adjacent panels (Photos 9 & 10)? If yes, record the approximate number of panels in the wall with cracking.	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
24-Are there cracks that continue horizontally through adjacent panels (Photos 9 & 10)? If yes, record the approximate number of panels in the wall with cracking.	Y	N	N/A	UNKN	24-Are there cracks that continue horizontally through adjacent panels (Photos 9 & 10)? If yes, record the approximate number of panels in the wall with cracking.	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
25-Are the panel corners making contact with each other? If yes, record the approximate number in the wall.	Y	N	N/A	UNKN	25-Are the panel corners making contact with each other? If yes, record the approximate number in the wall.	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
26-Are the panel corners "popped-off" or chipped from contact with an adjacent panel? If yes record the number in the wall.	Y	N	N/A	UNKN	26-Are the panel corners "popped-off" or chipped from contact with an adjacent panel? If yes record the number in the wall.	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
27-Does crack spacing suggest Differential Settlement?	Y	N	N/A	UNKN	27-Does crack spacing suggest Differential Settlement?	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
28-Does the overlying coping exhibit Vertical Offset?	Y	N	N/A	UNKN	28-Does the overlying coping exhibit Vertical Offset?	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
29-Are the coping and parapets loose or detaching? If yes, it may be appropriate to construct UDOT if detachment seems imminent.	Y	N	N/A	UNKN	29-Are the coping and parapets loose or detaching? If yes, it may be appropriate to construct UDOT if detachment seems imminent.	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
30-Are the panels in danger of falling off? (If possible) enter contact appropriate UDOT region.	Y	N	N/A	UNKN	30-Are the panels in danger of falling off? (If possible) enter contact appropriate UDOT region.	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
31-Are the panels bulging (bowing horizontally)? If so, record maximum deformation from acceptable coping to leveling pad. (Photo 11)	Y	N	N/A	UNKN	31-Are the panels bulging (bowing horizontally)? If so, record maximum deformation from acceptable coping to leveling pad. (Photo 11)	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
32-Is there slippage at the top or bottom of the wall? (Record maximum degree of slippage from struth)	Y	N	N/A	UNKN	32-Is there slippage at the top or bottom of the wall? (Record maximum degree of slippage from struth)	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

6

Cracked

MISE TOP OF WALL OBSERVATIONS

Required Task	Yes	No	N/A	UNKN	Top Of Wall	Measurement/Extent of Problem/Location/Photo Numbers
33-Is there evidence of settlement at the top of the wall? (permanent cracking, etc)	Y	N	N/A	UNKN	33-Is there evidence of settlement at the top of the wall? (permanent cracking, etc)	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
34-Are there any open cracks in the concrete coping (not hairline)? If yes record the approximate maximum crack width.	Y	N	N/A	UNKN	34-Are there any open cracks in the concrete coping (not hairline)? If yes record the approximate maximum crack width.	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
35-Is there the construction joint in the concrete coping spread up? (Photo 6) If yes, record the maximum joint width.	Y	N	N/A	UNKN	35-Is there the construction joint in the concrete coping spread up? (Photo 6) If yes, record the maximum joint width.	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

Required Tests:		Pass/Fail	Notes
Y	N/A	UN	36-Is there a large gap between the approach slab and the approach pavement? (Photo 15) Other slab produces a bumping sensation as the vehicle is crossed. Record the approximate maximum gap size.
Y	N/A	UN	37-A) The abutments, how the joint between the wall coping and the abutment opened up significantly? If so record maximum distance.
Y	N/A	UN	38-Is the coping wall pulling away from pavement/voids by sections? Please record maximum displacement for wall.

Required Tests:		Pass/Fail	Notes
Y	N/A	UN	39-What is the location depth of weathering? Please Give Probe into wall located 2 inches from wall to a maximum depth of 24 inches (24 inches is the minimum depth for MSE Wall).
Y	N/A	UN	40-Is leveling pad exposed?
Y	N/A	UN	41-Is there cracking in the leveling pad? If so, record maximum crack size with gauge.
Y	N/A	UN	42-Is there a four foot bench (level slope) directly along the wall before the slope changes (Record Width)?
Y	N/A	UN	43-Is there a slope steeper than V: 1.5 to 1H: 1 in front of the wall? Please record slope and height of wall.
Y	N/A	UN	44-Is the slope greater than V: 1.5 to 1H: 1 below the wall? Please record slope and height of backfill below the wall.
Y	N/A	UN	45-Is there excessive degradation of panel face?

Required Tests:		Pass/Fail	Notes
Y	N/A	UN	46-Is there excessive corrosion on guardrails or other exposed metal that might indicate corrosive conditions?
Y	N/A	UN	47-Are there major rust stains on the face panels? Along joints? If so, record total number.
Y	N/A	UN	48-Is any internal damage exposed? Does there appear to be corrosion on these strips? If applicable please record the total number of strips affected.
Y	N/A	UN	49-Was a redoximetry sample taken of exposed wall? If so, please indicate depth in inches.
Y	N/A	UN	50-Is there any indication of rebar corrosion (cracking, bare, rust, exposed metal inside epoxy coating)? If so please record the total number of panels affected.

Required Tests:		Pass/Fail	Notes
Y	N/A	UN	51-Are guardrails wall protrusions in place at the base of the wall (to prevent them from potential failure)?
Y	N/A	UN	52-Does it appear that the wall has been involved in an accident (repainted panel, recent dips in the wall)?
Y	N/A	UN	53-Does it appear the wall's functionality and integrity has been compromised by a collision or accident?

Required Tests:		Pass/Fail	Notes
Y	N/A	UN	54-Are there acute wall angles (<90)?

Required Tests:		Pass/Fail	Notes
Y	N/A	UN	55-Are there available drawings for the wall? Please indicate type (Standard and Layout, Design, As Built, etc.)
Y	N/A	UN	56-Is the layout in general accordance with drawings?
Y	N/A	UN	57-Are the panels CIP (Cast in Place)? Does there appear to be excessive cracking in the panels?
Y	N/A	UN	58-Was GEOFORM used in the construction of the wall?
Y	N/A	UN	59-Are there any structures on or near wall that were not included in initial drawings?
Y	N/A	UN	60-Are there any impurities, utilities, or structures that are not part of the initial drawings?
Y	N/A	UN	61-How have there been any excavations or encroachment of encroachment near the wall?
Y	N/A	UN	62-How have local property owners changed the dynamics of the wall (additional structures, irrigation, vegetation, etc.)?
Y	N/A	UN	63-Are there piles located in the wall (bridge abutment)?

MSE STABILITY

MSE METAL CORROSION

MSE IMPACT COLLISION PROTECTION

MSE OBSTRUCTIONS IN REINFORCEMENT GEOMETRY

MSE AS BUILT DIFFERENT FROM DESIGN