

STATE OF UTAH MSE WALL INSPECTION FORM

Compiled As Part of Research By The Utah Department of Transportation

Instructions:

- 1- Fill out required sections for MSE Wall Inspector and Wall Characteristics.
- 2- Inspect the wall using the attached form. Questions that require a "Yes" answer should be documented by noting the extent of the problem in the right most column and photo documentation. Photo documentation should consist of wall or bridge number, nature of problem, date, photo number for wall, and a size reference, which should be indicated in the photo (white board/paper). Photos taken should be placed on the Top View layout and indicated with the appropriate number. Note should be taken by the inspector that often anomalies are due to construction and should be distinguished from those that are a result of post-construction. If it is observable that they existed at the time of construction note should be taken in the space provided for drawings.
- 3- Shoot digital photos of the entire wall. This may require the use of a variety of shots and angles on each wall to cover the wall in its entirety.
- 4- Indicate Layout of MSE Wall in respect to major intersections, roadways, potential hazards, irrigation, vegetation, locations of conditions for which "Yes" was marked, etc. in space provided below. Also Indicate approximate GPS Coordinates of Site of Interest in space provided below

Inspector Information

Inspection Date	11/10/2007	Names Of Inspectors	RM #112
Region	2	Identifying Road/Intersection	5300 SOUTH & UPRR / LIGHT RAIL


MSE WALL CHARACTERISTICS

MSE Wall at Bridge	Y N	Bridge Number if applicable:	UKN	Wall Number	R-427
Surrounding Structures	LIGHT RAIL / COMMERCIAL / UPRR			Maximum Height of Wall (ft)	30 FT
Distance to Each Structure	10'	↳ POWER SUBSTATION		One Stage, Two Stage or Block Wall	CIP/TILT UP
State Route Number				Estimated Max Length of Wall Abutment:	200 FT
Approximate Mile Marker				Max Slope of Ground in front of wall:	0
GPS Datum	WGS/84	NAD/83, or NAD/27		Max Height of wall burial line above surrounding level ground:	0
MSE Wall GPS Coordinates (Location of Measurement shown on plan view)	N. 40° 39.273		Please draw rough layout of panel with approximate dimensions in space provided below:		
	W 111° 53.882				
If known, Panel or System Manufacturer	UKN				

Summary of Key Observations:

NO ACCESS - SECURITY FENCES & RAILROAD LIMIT ANY ACCESS TO SITE.

LANDSCAPED BLOCK WALLS LOCATED NEAR 5300 SOUTH & NEAR POWER SUBSTATION BY BRIDGE

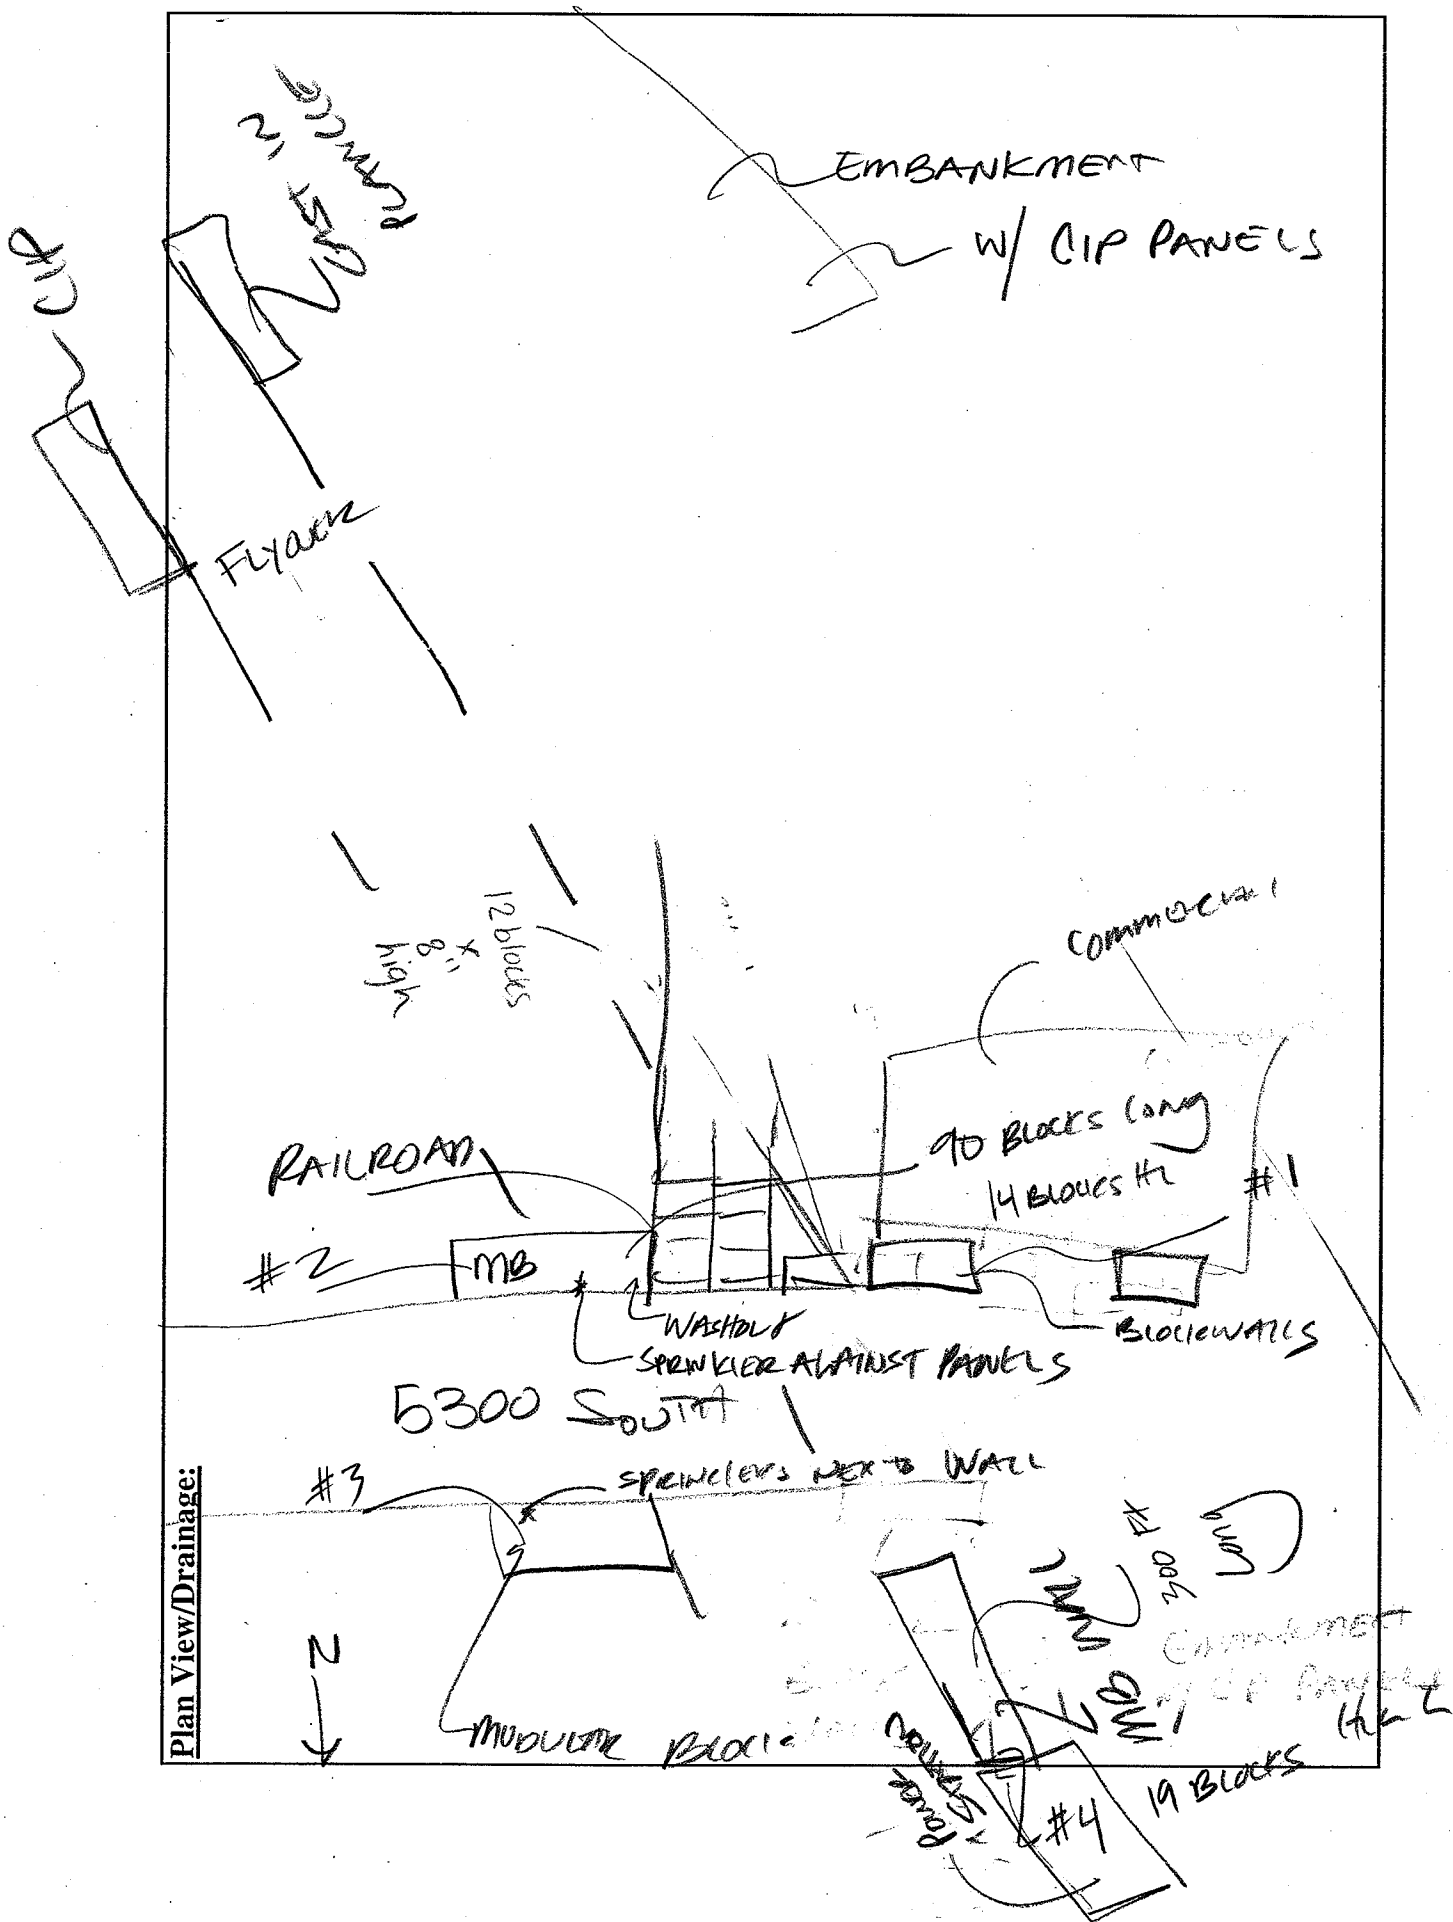

Plan View/Drainage:

Cross Sections:

Cross Sections:

50% tilt up 80% Moisture Block

MSE WALL FACING

Required Tools: Long Level-String-GPS-Camera-Crack Gauge		Yes	No	UKN	Wall Facing	Measurement/Extent of Problem/Location/Photo Numbers											
Yes	No					UKN	1%	5%	10%	25%	50%	75%	90%	95%	100%		
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		22-Are the panels "Tilt-Up"? Is there excessive cracking in the panels?	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		23-Are there cracks that continue vertically through adjacent panels (Photos 9 & 10)? If yes, record the approximate number of panels in the wall with cracking.	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		24-Are there cracks that continue horizontally through adjacent panels (Photos 9 & 10)? If yes, record the approximate number of panels in the wall with cracking.	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		25-Are the panel corners making contact with each other? If yes, record the approximate number in the wall.	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		26-Are the panel corners "popped-off" or chipped from contact with an adjacent panel? If yes record the number in the wall.	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		27-Does crack spacing suggest Differential Settlement?	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		28-Does the overlying coping exhibit Vertical Offset?	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		29-Are the coping and parapets loose or detaching? If yes, it may be appropriate to contact UDOT if detachment seems eminent.	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		30-Are the panels in danger of falling off? (If potential exists contact appropriate UDOT region).	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		31-Are the panels 'bulging' (bowing horizontally)? If so, record maximum deformation from accessible coping to leveling pad. (Photo 11)	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		32-Is there 'tipping' at the top or bottom of the wall? (Record maximum degree of tipping from azimuth using vertical level and affected area).	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/

Block wall

MSE TOP OF WALL OBSERVATIONS

Required Tools: Long Level-Crack Gauge-GPS-Camera		Yes	No	UKN	Top Of Wall	Measurement/Extent of Problem/Location/Photo Numbers											
Yes	No					UKN	1%	5%	10%	25%	50%	75%	90% <th>95% <th>100% </th></th>	95% <th>100% </th>	100%		
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		33-Is there evidence of settlement at the top of the wall? (pavement cracking, etc)	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		34-Are there any open cracks in the concrete coping (not hairlines)? If yes record the approximate maximum crack width.	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		35-Have the construction joints in the concreting coping opened up? (Photo 6). If yes, record the maximum joint width.	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		36-Is there a large gap between the approach slab and the approach pavement? (Photo 15) Often this produces a bumping sensation as the overpass is crossed. Record the approximate maximum gap size.	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		37-At the abutments, has the joint between the wall coping and the abutment opened up significantly? If so record maximum distance.	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		38-Is the coping/wall pulling away from pavement/roadway section? Please record maximum displacement for wall.	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/

MSE STABILITY

Required Tools: Shovel, GEO-Probe		Yes	No	UKN	Structural Integrity	Measurement/Extent of Problem/Location/Photo Numbers											
Yes	No					UKN	1%	5%	10%	25%	50%	75%	90% <th>95% <th>100% </th></th>	95% <th>100% </th>	100%		
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		39-What is the location depth of Leveling pad? Pound Geo-Probe into soil located 2 inches from wall to a maximum depth of 24 inches (24 inches is the minimum depth for MSE Wall)	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		40-Is leveling pad exposed?	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		41-Is there cracking in the leveling pad? If so, record maximum crack size with gage.	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		42-Is there a four foot 'bench' (level slope) directly along the wall before the slope changes (Record Width)?	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		43-Is there a slope steeper than V: 1.5 to H: 1 in front of the wall? Please record slope and height of backfill above top of wall.	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		44-Is there a slope greater than V: 1.5 to H: 1 below the wall? Please record slope and height of backfill below the wall.	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/
		<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>		45-Is there excessive degradation of panel faces?	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%	/

1:3 to 1:2 (3:1)

MSE METAL CORROSION

Required Tools:		Nylon Mallet-Camera-GPS-Zip Lock-Bag-Trowel	Metal Corrosion	Measurement/Extent of Problem/Location/Photo Numbers										
Yes	No	N/A	UKN	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%
Y	(N)	N/A	UKN	46-Is there excessive corrosion on guardrails or other exposed metal that might indicate corrosive conditions?	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	47-Are there major rust stains on the face panels? Along joints? If so, record total number.	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	48-Are any internal straps exposed? Does there appear to be corrosion on these straps? If applicable please record the total number of straps affected.	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	49-Was a resistivity sample taken of exposed soil? If so, please indicate depth in inches.	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	50-Is there any indication of rebar corrosion (swelling bars, rust, exposed metal inside epoxy coating)? If so please record the total number of panels affected.	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%

MSE IMPACT/COLLISION PROTECTION

Required Tools:		Camera-GPS	Impact/Collision	Measurement/Extent of Problem/Location/Photo Numbers										
Yes	No	N/A	UKN	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%
Y	(N)	N/A	UKN	51-Are guardrails/wall protections in place at the base of the wall (to protect it from potential traffic hazards)?	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	52-Does it appear that the wall has been involved in an accident (replaced panel, recent dings in the wall)?	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	53-Does it appear the walls functionality and integrity has been compromised by a collision or accident?	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%

MSE OBSTRUCTIONS IN REINFORCEMENT GEOMETRY

Required Tools:		Drawings	Obstructions in Reinforcement Geometry	Measurement/Extent of Problem/Location/Photo Numbers										
Yes	No	N/A	UKN	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%
Y	(N)	N/A	UKN	54-Are there acute wall angles (<90)?	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%

MSE AS BUILT DIFFERENT FROM DESIGN

Required Tools:		Drawings-Camera-GPS	MSE as built different than design	Measurement/Extent of Problem/Location/Photo Numbers										
Yes	No	N/A	UKN	/	0-No	1%	5%	10%	25%	50%	75%	90%	95%	100%
Y	(N)	N/A	UKN	55-Are there available drawings for the wall? Please indicate type (Situation and Layout, Design, As Built, etc.)	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	56-Is the layout in general accordance with drawings? - Dings HAVE @ TIME OF WSRTT	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	57-Are the panels CIP (Cast in Place) Does there appear to be excessive cracking in the panels?	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	58-Was GEOFoam used in the construction of the wall?	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	59-Are there any structures on or near wall that were not included in initial drawings?	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	60-Are there any irrigation, utilities, or intrusions that are not part of the initial drawings?	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	61-Have there been any excavations or evidence of excavations near the wall?	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	62-Have local property owners changed the dynamics of the wall (additional structures, irrigation, vegetation, etc.)?	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%
Y	(N)	N/A	UKN	63-Are there piles located in the wall (bridge abutment)?	/	0-No	1%	5%	10%	25%	50%	75%	90%	100%

None Tilt up