

STATE OF UTAH MSE WALL INSPECTION FORM


Compiled As Part of Research By The Utah Department of Transportation

Instructions:

- 1-Fill out required sections for MSE Wall Inspector and Wall Characteristics.
- 2-Inspect the wall using the attached form. Questions that require a 'Yes' answer should be documented by noting the extent of the problem in the right most column and photo documentation. Photo documentation should consist of wall or bridge number, nature of problem, date, photo number for wall, and a size reference, which should be indicated in the photo (white board/paper). Photos taken should be placed on the Top View layout and indicated with the appropriate number. Note should be taken by the inspector that often anomalies are due to construction and should be distinguished from those that are a result of post-construction. If it is observable that they existed at the time of construction note should be taken in the space provided for drawings.
- 3- Shoot digital photos of the entire wall. This may require the use of a variety of shots and angles on each wall to cover the wall in its entirety.
- 4- Indicate Layout of MSE Wall in respect to major intersections, roadways, potential hazards, irrigation, vegetation, locations of conditions for which 'Yes' was marked, etc. in space provided below. Also indicate approximate GPS Coordinates of Site of Interest in space provided below

Region	4	Identifying Road/Intersection	SR-18 ledges interchange
---------------	---	--------------------------------------	--------------------------


MSE WALL CHARACTERISTICS

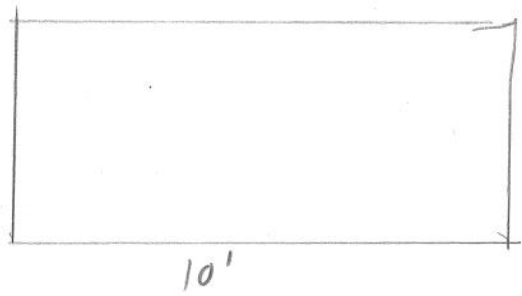MSE Wall at Bridge	(Y) N	Bridge Number if applicable:		Wall Number	460-B (crest)
Surrounding Structures				Maximum Height of Wall (ft)	16.5 ft
Distance to Each Structure				One Stage, Two Stage or Block Wall	
State Route Number	18			Estimated Max Length of Wall Abutment:	220 ft
Approximate Mile Marker	9			Max Slope of Ground in front of wall:	0
GPS Datum	WGS/84, NAD/83, or NAD/27			Max Height of wall burial line above surrounding level ground:	15 ft
MSE Wall GPS Coordinates (Location of Measurement shown on plan view)				Please draw rough layout of panel with approximate dimensions in space provided below:	
If known, Panel or System Manufacturer					

Summary of Key Observations:


coping pulling from slabs on north and south face

Plan View/Drainage:

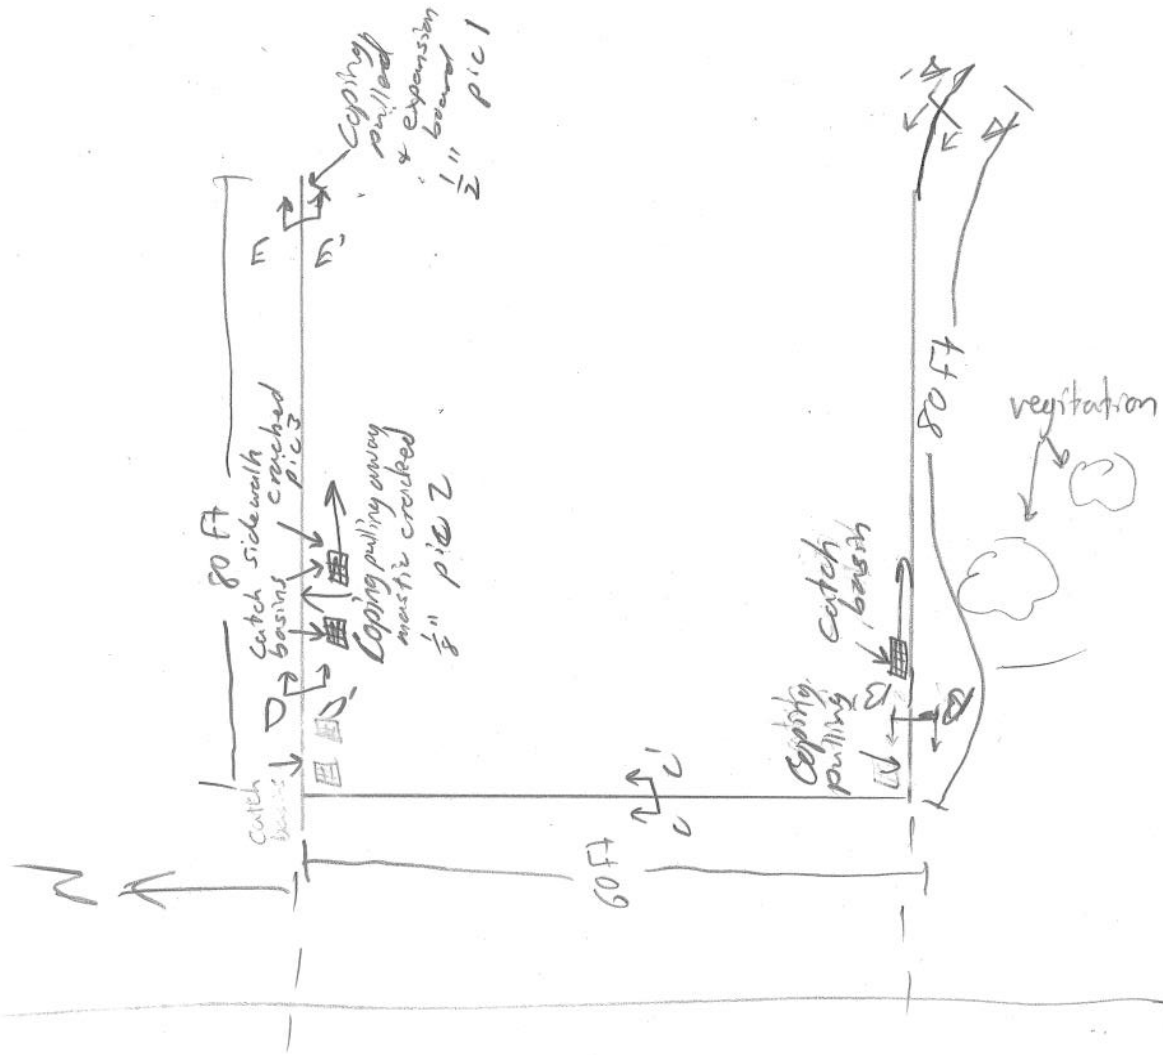


SR-18


Cross Sections:

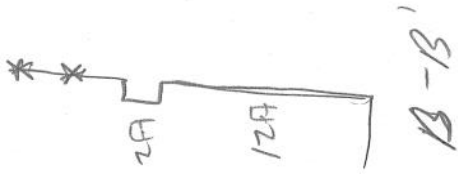

Cross Sections:

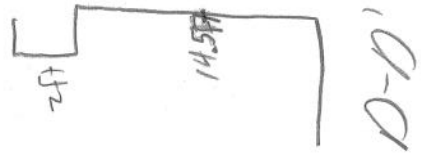

rocking due to
coping pulling
away.

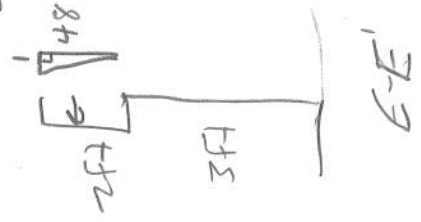

MSE WALL DRAINAGE

Required Item:	Yes	No	NA	UNS	Measurement/Extent of Problem/Location/Photo Numbers
1-Is there an active water source near the toe of the wall (to the wall near a body of water with seepage potential)?	Y	N	N/A	UNS	Drainage / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
2-If applicable, are the catch basins at the base of the wall blocked?	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
3-Are there culverts protruding through the wall?	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
4-Are there vertical drains that travel through the backfill?	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
5-Is there erosion at the base of the wall or leveling pad? (Photo 12)	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
6-Is there erosion along the wing wall?	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
7-Are there any signs of water flow along the base of the wall?	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
8-Does the backfill or joint fabric appear to be saturated?	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
9-Is there vegetation growing in joint joints (Photo 9)?	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
10-Is there vegetation growing in panel joints (Photo 14)	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
11-Are the deck, drains and outside at the top of the wall blocked? (Photo 14)	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
12-Can water enter the wall between coping and abut (i.e., Drains appropriately)?	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
13-Is there evidence of discharge points of fill seeping through drain pipes?	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

MSE WALL JOINTS

Required Item:	Yes	No	NA	UNS	Measurement/Extent of Problem/Location/Photo Numbers
14-Is backfill coming out of joints or are there piles of backfill at the base of the wall? (Pictures 2 & 3)	Y	N	N/A	UNS	Blocked / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
15-Are the joints wide enough to see fabric or backfill behind panels when looking into joint? (Photo 5) If yes, record the approximate maximum joint width in inches.	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
16-Is exposed backfill visible in the horizontal joint? (Photo 4)	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
17-Are there visible tears in the fabric? Is there evidence of backfill or water leaking through tear? (Do not induce additional damage to fabric)	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
18-Do the joints have a non-uniform horizontal spacing due? Are some horizontal joints larger/smaller than others? (Photo 5)	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
19-Are there any non-uniform vertical spacing due? Are some vertical joints larger/smaller than others? (Photo 6)	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
20-Are the panels offset at the joints either in or out of the wall? (Photo 7) If yes, record the approximate maximum offset.	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
21-Does the fabric appear brittle, or appear as if it has undergone excessive UV exposure?	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

on purpose w/ cloth

MSE WALL FACING

Required Item:	Yes	No	NA	UNS	Measurement/Extent of Problem/Location/Photo Numbers
22-Are the panels "tilt up"? Is there excessive cracking in the panels?	Y	N	N/A	UNS	Wall Facing / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
23-Are there cracks that continue vertically through adjacent panels (Photos 9 & 10)? If yes, record the approximate number of panels in the wall with cracking.	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
24-Are there cracks that continue horizontally through adjacent panels (Photos 9 & 10)? If yes, record the approximate number of panels in the wall with cracking.	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
25-Are the panel corners cracking contact with each other? If yes, record the approximate number in the wall.	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
26-Are the panel corners "popped off" or abraded from contact with an adjacent panel? If yes, record the number in the wall.	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
27-Does crack spacing suggest Differential Settlement?	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
28-Does the overlying coping exhibit Vertical Offset?	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
29-Are the coping and parapets loose or disintegrating? If yes, it may be appropriate to contact UDOT if detachment occurs routinely.	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
30-Are the panels in danger of falling off? (If potential exists contact appropriate UDOT region).	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
31-Are the panels bulging (bowing horizontally)? If so, record maximum deformation from acceptable coping to leveling pad. (Photo 11)	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
32-Is there "sipping" at the top or bottom of the wall? (Record maximum degree of sipping from abutment using vertical level and affected area).	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

both sides

MSE TOP OF WALL OBSERVATIONS

Required Item:	Yes	No	NA	UNS	Measurement/Extent of Problem/Location/Photo Numbers
33-Is there evidence of settlement at the top of the wall? (gas/water cracking, etc)	Y	N	N/A	UNS	Top Of Wall / 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
34-Does any open cracks in the concrete coping (not hairline)? If so, record the approximate maximum crack width.	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
35-Does the construction joint in the concrete coping appear open? (Photo 6) If yes, record the maximum joint width.	Y	N	N/A	UNS	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

cracked sidewalk

Y	N	NA	UNS	UNK	Required Tests:	Notes	Measurement/Extent of Problem/Location/Photo Numbers
<input checked="" type="checkbox"/>					13c-Is there a large gap between the approach slab and the approach pavement? (Please 13) Other than producers a bumping sensation as the approach is crossed. Record the approximate maximum gap size.		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					17-At the abutment, has the joint between the wall coping and the abutment opened up significantly? If so record maximum distance.		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					18-Is the coping wall pulling away from pavement roadway section? Please record maximum displacement.		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

BASE STABILITY							
Y	N	NA	UNS	UNK	Required Tests:	Notes	Measurement/Extent of Problem/Location/Photo Numbers
<input checked="" type="checkbox"/>					19-What is the location depth of leveling pad? Found One Probe line well located 2 inches from wall to a maximum depth of 24 inches (24 inches is the minimum depth for MSE Wall)		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					20-Is leveling pad exposed?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					21-Is there cracking in the leveling pad? If so, record maximum crack size with pages.		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					22-Is there a four foot bench (level dip) directly along the wall before the slope changes (Record bench) above top of wall.		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					23-Is there a slope steeper than V:1.5 to H:1 in front of the wall? Please record slope and height of bench below the wall.		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					24-Is there a slope greater than V:1.5 to H:1 below the wall? Please record slope and height of bench below the wall.		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					25-Is there excessive degradation of panel face?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

MSE METAL CORROSION							
Y	N	NA	UNS	UNK	Required Tests:	Notes	Measurement/Extent of Problem/Location/Photo Numbers
<input checked="" type="checkbox"/>					46-Is there excessive corrosion on guardrails or other exposed metal that might indicate corrosive conditions?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					47-Are there major rust stains on the face panels? Along joints. If so, record stain number.		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					48-Are any internal straps exposed? Does there appear to be corrosion on these straps? If applicable please record the total number of straps affected.	<i>Although, I could not be able to tell</i>	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					49-Was a rebar visible when taken of exposed wall? If so, please indicate depth in inches.		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					50-Is there any indication of rebar corrosion (cracking bars, rust, exposed metal inside epoxy coating)? If so please record the total number of panels affected.		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

MSE IMPACT/COLLISION PROTECTION							
Y	N	NA	UNS	UNK	Required Tests:	Notes	Measurement/Extent of Problem/Location/Photo Numbers
<input checked="" type="checkbox"/>					51-Are guardrails wall projections in place at the base of the wall to prevent it from potential traffic hazard?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					52-Does it appear that the wall has been involved in an accident (replaced panel, recent dips in the wall)?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					53-Does it appear the walls functionality and integrity has been compromised by a collision or accident?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

MSE OBSTRUCTIONS IN REINFORCEMENT GEOMETRY							
Y	N	NA	UNS	UNK	Required Tests:	Notes	Measurement/Extent of Problem/Location/Photo Numbers
<input checked="" type="checkbox"/>					54-Are there acute wall angles (<90°)?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /

MSE AS BUILT DIFFERENT FROM DESIGN							
Y	N	NA	UNS	UNK	Required Tests:	Notes	Measurement/Extent of Problem/Location/Photo Numbers
<input checked="" type="checkbox"/>					55-Are there available drawings for the wall? Please indicate type (Situation and Layout, Design, As Built, etc.)		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					56-Is the layout in general accordance with drawings?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					57-Are the panels CIP (Cast in Place) Does there appear to be excessive cracking in the panels?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					58-Was GEOFabric used in the construction of the wall?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					59-Are there any structures on or near wall that were not included in field drawings?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					60-Are there any inclusions, utilities, or intrusions that are not part of the field drawings?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					61-Have there been any excavations or evidence of excavations near the wall?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					62-Have local property owners changed the dynamics of the wall (additional structures, irrigation, vegetation, etc.)?		/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /
<input checked="" type="checkbox"/>					63-Are there piles located in the wall (bridge abutment)?	<i>Caissons</i>	/ 0-No 1% 5% 10% 25% 50% 75% 90% 95% 100% /